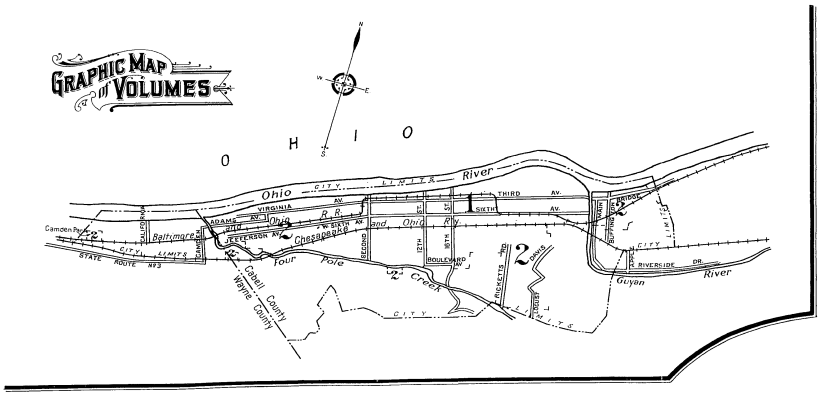

KEY TO SYMBOLS

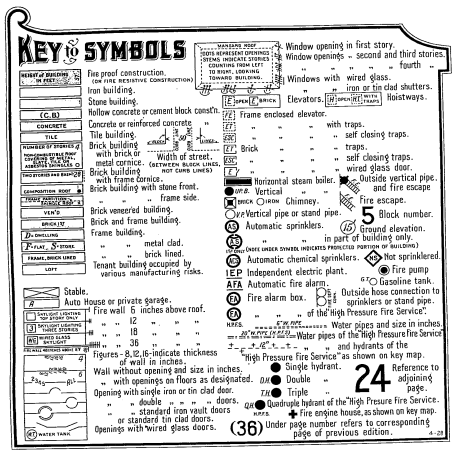

CORRECTION RECORD

REV'N NO.	DATE OF CORRECTION	ATTACHED BY	DATE ATTACHED

POPULATION 75,000

Prevailing Winds:—West and Southwest.

GRADES:—Level. About 146 miles of brick, concrete and asphalt paved streets, balance hard surfaced.

PUBLIC LIGHTS:—Electric.

WATER FACILITIES

Huntington Water Works Co. (privately owned). Gravity and direct pressure system. Supply from Ohio River.

GUYAN PUMPING STATION.—2 Worthington electric centrifugal pumps, capacity 6,000,000 gallons per 24 hours. 1 DeLaval booster electric centrifugal pump, capacity 7,000,000 gallons when connected with one of the Worthington pumps.

TWENTY-FOURTH STREET PUMPING STATION.—1 Hall steam pump, capacity 2,000,000 gallons per 24 hours. 2 Worthington steam pumps, capacity 2,500,000 gallons each per 24 hours. 1 Gordon steam pump, capacity 2,000,000 gallons per 24 hours. 1 Worthington steam pump, capacity 5,000,000 gallons per 24 hours. 1 Wood steam pump, capacity 5,000,000 gallons per 24 hours. 1 Lea-Courtenay steam centrifugal pump, capacity 5,000,000 gallons per 24 hours. 2 steel sedimentation tanks, combined capacity 706,000 gallons. 1 concrete sedimentation basin, capacity 1,000,000 gallons.

RITTER HILL BOOSTER STATION.—1 American-Marsh electric centrifugal pump, capacity 144,000 gallons per 24 hours. 1 Worthington electric centrifugal pump, capacity 576,000 gallons per 24 hours.

Guyan Station located 4¾ miles from Court House. Twenty-fourth Street Station located 2 miles from Court House. Reservoir capacity 2,500,000 gallons. Standpipe capacity 90,000 gallons.

About 100 miles of 4" to 30" mains. 842 hydrants. Average daily consumption 5,000,000 gallons. Domestic pressure 60 lbs., fire pressure 110 lbs. in business section.

FIRE DEPARTMENT

Fully paid. 1 chief, 2 assistant chiefs and 88 men. 8 stations, fully motorized.

1 American-LaFrance 85' aerial ladder truck. One 1,000 gallon American-LaFrance pumper and hose truck, one 40 gallon chemical tank and 1,200' 2½" hose. 1 Seagrave service truck, 400' 2½" hose, 400' 1½" hose and ladders. Four 750 gallon Seagrave pumper trucks, carrying a total of 5,200' 2½" hose and one 80 gallon water tank each. 1 American-LaFrance combination hose and chemical truck, two 40 gallon chemical tanks, 1,000' 2½" hose. One 650 gallon Seagrave special pumper, 1,400' 2½" hose and one 100 gallon water tank. One 750 gallon American-LaFrance pumper truck, one 40 gallon chemical tank and 1,200' 2½" hose. 1 American-LaFrance chemical truck, one 40 gallon chemical tank and 1,200' 2½" hose. One 750 gallon American-LaFrance pumper truck, one 40 gallon chemical tank and 1,000' 2½" hose, held in reserve. 1 Auburn chief's car, 1 Ford assistant chief's car, 1 Reo utility truck, 1 Studebaker ambulance. Total amount of hose in service 23,400' 2½" hose and 400' 1½" hose, 15,000' 2½" hose held in reserve.

Gamewell fire alarm system. 136 boxes. Fire alarm headquarters located (on sheet 24), at 816 Ninth St., in one-story tile brick faced building. Alarm also given by telephone.

FIRE-RESISTIVE ROOFING ORDINANCE

Ordinance prohibiting wooden shingle roofs within fire limits only, adopted 1925. No set date for roofs to be replaced by fire-resistive roofing.

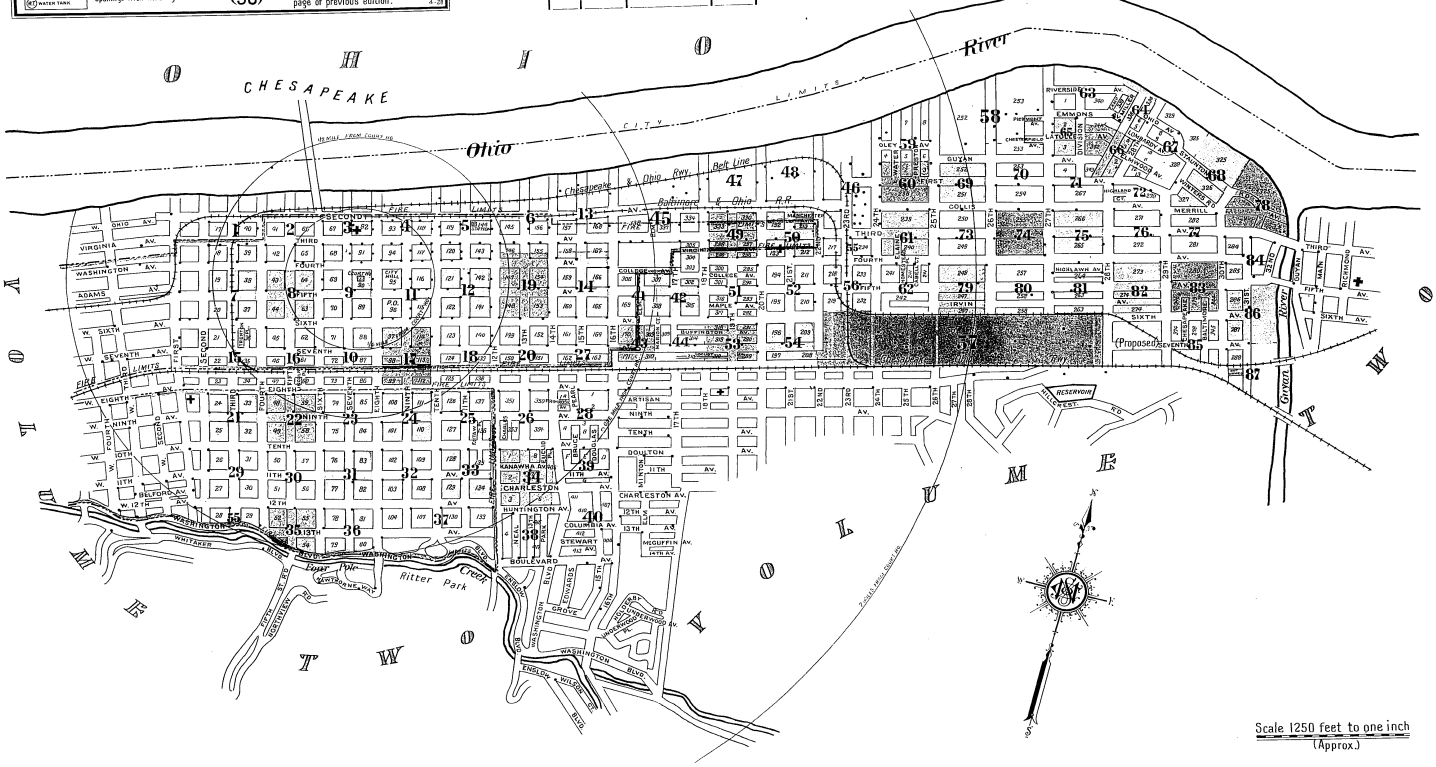

Copyright 1931 by the Sanborn Map Co.